

GHG EmissionsReduction Audit

A Checklist for Owners





Contents

Introduction	4
How to Use this Resource	4
Audience	4
GHG Emissions Reduction Audit Guidance	5
Task 1: Data Collection and Target Setting	6
Compile Building Documentation and Energy Data	6
Calculate Scope 1 and 2 Emissions	6
Building-level GHG Emissions Reduction Targets	6
Task 2: On-site Inspections	7
On-site Inspection Scope	7
Initial Assessment Report (IAR)	7
Task 3: Analysis and Reporting	8
Emissions Reduction Measures	8
Low-Emissions Measure Packages	9
Emissions Reduction Audit Report	9
Task 4: Selection and Implementation by Owner	10
Optional Audit Scope	10
Electrical Panel Load Study	10
Existing Building Commissioning or Monitoring-based Commissioning	10
Energy Storage Assessment	10
Demand Management and Load Flexibility Assessment	11
EV Charging Assessment	11
Greenhouse Gas Emissions Reduction Audit Checklist	12
Task 1: Data Collection and Goal Setting	12
Task 2: On-site Inspections	12
Task 3: Analysis and Reporting	13
Task 4: Selection and Implementation (Owner tasks)	14
Appendix A: Resources	15
Appendix B: Audit Deliverables	16
Initial Assessment Report (IAR) Outline	16
Emission Reduction Audit Report Outline	17

Acknowledgments

The U.S. Department of Energy recognizes the reviewers of the GHG Emissions Reduction Audit: A Checklist for Owners for their significant contributions to this work. As a part of the Better Climate Challenge and its Emissions Reduction Planning Working Group, partners provided valuable input based on their experiences implementing decarbonization strategies in their organizations. Industry professionals that served as expert reviewers included members of ASHRAE's Task Force for Building Decarbonization, ASHRAE Standard 211 subject matter experts, Paul Torcellini (National Renewable Energy Laboratory), Stet Sanborn (SmithGroup), Supriya Goel (Pacific Northwest National Laboratory), and Tom Abrams (Introba).

Authors

Hannah Kramer, Lawrence Berkeley National Laboratory Affiliate Dan Luddy, PAE

Nora Hart, Lawrence Berkeley National Laboratory

Jessica Granderson, Lawrence Berkeley National Laboratory

Better Climate Challenge Buildings Program Lead

Hannah Debelius, U.S. Department of Energy

February 2023

Better Climate Challenge Emissions Reduction Planning Working Group Participants

American Hotel & Lodging Association

American Society for Healthcare Engineering (ASHE)

Bullitt County Public Schools, KY

BXP

California State University, Sacramento

Chula Vista, CA

Community Housing Partners

Dallas, TX

Elevate Energy

Exelon Corporation

Fairfax County, VA

Foundation Communities

Hillsboro, OR

Housing Authority City of Pittsburgh

ICLEI: Local Governments for Sustainability

Jamestown

King County Housing Authority

Knoxville, TN

La Crosse, WI

LaSalle Investment Management

Los Angeles Unified School District, CA

Louisville, KY

Mayo Clinic

Mercy Housing

MGM Resorts International

Paramount Pictures

RXR

Sabey Data Centers

San Diego, CA

Schochet Companies

Seattle Housing Authority

Southampton, NY

Standard Communities

State of Maryland

Stewards of Affordable Housing for the Future

Tenderloin Neighborhood Development Corporation

The Tower Companies

University of Virginia

U.S. Green Building Council (USGBC)

Veris Residential

Worcester, MA

Introduction

This resource includes guidance and an accompanying checklist that details recommended services and deliverables for a building-level greenhouse gas (GHG) emissions reduction audit for operational Scope 1 and 2 GHG emissions¹. The GHG emissions reduction audit scope is compatible with an ASHRAE Standard 211 Level 2 energy audit or ISO 50002 Tier 2 energy audit, including a similar investigation to reduce on-site energy consumption, but with a few key differences.

The emissions reduction audit specified in this guidance document:

- Includes a calculation of GHG emissions reductions in addition to energy and utility cost savings.
- ► Focuses on major equipment and all fossil-fuel combustion equipment. An exhaustive inventory of all heating, ventilation, and air conditioning (HVAC) equipment may not be required.
- Includes evaluation of the following GHG emissions reduction strategies:
 - ▶ Reduce or eliminate on-site fossil-fuel combustion through electrification and system efficiency improvements.
 - ▶ Reduce or eliminate fugitive emissions from refrigerants.
 - ▶ Install on-site renewable energy sources.
- ▶ Results in a long-term plan, with consideration of phased implementation of measures to align with capital planning activities.

The audit will determine achievable levels of emissions reductions at a building through energy efficiency, electrification, fugitive emissions reduction, and the addition of onsite renewable energy. Additional emissions reduction audit services such as off-site renewables, energy storage, and electric vehicle (EV) charging are listed as optional in this guidance but may be included in the audit scope. This audit guidance focuses on identifying on-site actions and does not include analysis of renewable energy credits or green power purchases, which are generally considered at a portfolio level. Deep emissions reductions at the building level will reduce the need for renewable energy credits (RECs) and green power purchases.

How to Use this Resource

This document consists of two main sections: (1) the GHG Emissions Reduction Audit Guidance, and (2) the GHG Emissions Reduction Audit Checklist. The guidance portion includes a detailed description of each task that should be carried out by an Auditor, with examples. The owner can use the checklist to validate the scope of the audit. Both sections are meant to be used in parallel with one another.

Owners or organizations with portfolio-level GHG emissions reduction targets can use this resource in parallel with the U.S. Department of Energy's (DOE's) Framework for Portfolio-level GHG Emissions Reduction Planning (Kramer et., 2023). The framework outlines how to scale the results of a building-level audit across a portfolio of buildings.

Audience

This guidance is intended to be used by building owners to help develop a GHG emissions audit scope of work that is comprehensive and effective, resulting in building-level solutions that will reduce operational emissions to meet targets. Additional resources are provided in Appendix A.

¹Scope 1 emissions consist of direct GHG emissions from sources controlled or owned by an organization such as boilers, furnaces, and vehicle fleets. Scope 2 emissions are indirect GHG emissions associated with the purchase of electricity, steam, heating, or cooling.




GHG Emissions Reduction Audit Guidance

A GHG emissions reduction audit can be broken into four specific tasks, as defined in Figure 1. At a minimum, the audit will involve the following parties:

- Building owner or owner's representative such as a property manager (owner)
- ▶ GHG emissions reduction auditor (auditor)
- ▶ Building engineer and/or building operator (operator)

Figure 1. Tasks in a GHG Emissions Reduction Audit

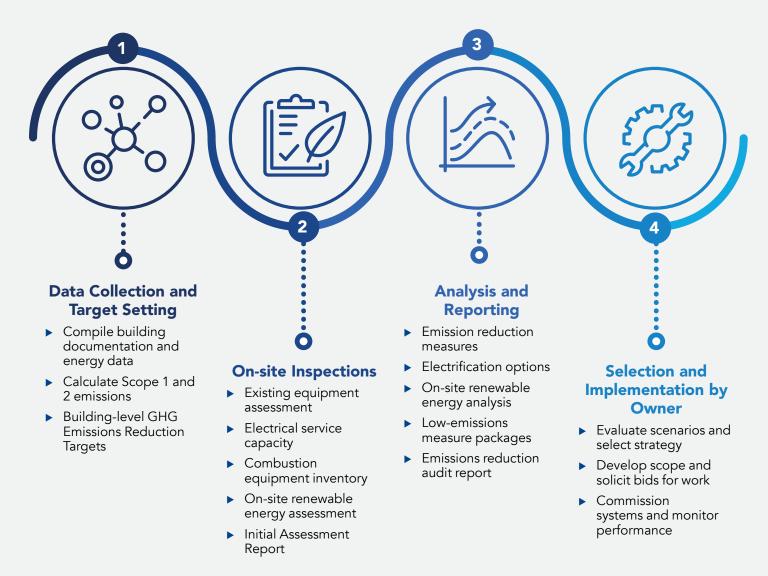

Optional Audit Scope

- Electrical panel load study
- Existing building commissioning or monitoring-based commissioning
- Energy storage assessment
- ▶ Demand management and load flexibility assessment
- ▶ EV charging assessment



Data Collection and Target Setting

Coordination between the auditor and owner on the goals of the audit will enable the auditor to develop emissions reductions measures that align with the owner's anticipated plans for the building. The two main goals in Task 1 are to define current operational emissions and to develop building-level GHG emissions reduction targets that will guide the audit.

Compile Building Documentation and Energy Data

The owner should compile relevant building documentation and share it with the auditor for review. Utilizing existing information will minimize the time spent collecting HVAC system information, and the GHG emissions reduction audit can build upon any energy efficiency improvements already implemented. Relevant information can include:

- As-built drawings
- Equipment inventories and cut sheets
- Property condition assessments and capital plans
- Refrigerant leakage and repair documentation
- Prior energy or GHG emission reduction audits (completed within the past five years)
- Access to data from a building automation system

The auditor will work with the owner to compile monthly historical energy consumption to determine annual consumption of electricity, natural gas, and any other sources (including on-site renewable energy) and their associated GHG emissions. The owner is encouraged to provide at least five years of data, including data from 2019 or earlier, to benchmark typical operation prior to COVID disruptions.

Calculate Scope 1 and 2 Emissions

The historical energy consumption data can be used to calculate the building's Scope 1 and 2 emissions. The owner and auditor should agree on applicable GHG emissions factors for all energy sources prior to the detailed analysis portion of the audit. Industry standard emission factors are published by the U.S. Environmental Protection Agency (EPA) and Intergovernmental Panel on Climate Change (IPCC).

If the building's emissions have been calculated for previous years as part of a GHG inventory, the owner can share them directly with the auditor to avoid duplication of effort.

Building-level GHG Emissions Reduction Targets

The auditor will collaborate with the owner to establish GHG emissions reduction targets for the building. The owner may instruct the auditor to evaluate multiple targets or offer projections for options that are phased over time to align them with long-term capital plans.

The building-level targets may be informed by:

- ▶ Short- and long-term plans for the building
- ► Long-term capital plans and upcoming equipment replacements
- Changes in occupancy
- Desired financial analysis needed (simple payback, net present value [NPV])
- ▶ The owner's portfolio-level emission reduction plans
- Local building performance standards and GHG emission reduction legislation

The building may be in a jurisdiction with local building performance standards that mandate a targeted energy and GHG emissions level for the building. The auditor should provide an overview of current jurisdictional requirements and any future requirements that are being developed by state and local governments. These requirements could influence the goals for the audit.

As noted in the introduction, unless desired by the owner, RECs and green power purchases will not be evaluated. Deep emission reductions at the building level will reduce the need for RECs and green power purchases.

The emissions reduction target may require adjustment based on the outcome of the audit analysis. If it is too costly or not technically feasible to meet the emission reduction target, then the target may need to be lowered based on conversations between the owner and auditor. However, the intent of this audit is to offer pathways to deep emission reductions, beyond what is typically identified through energy audits.



On-site Inspections

On-site inspections provide the auditor with invaluable information to inform emission reduction options. Task 2 results in an initial assessment report that the auditor will review with the owner, which will inform the next two tasks.

On-site Inspection Scope

The auditor's on-site inspection will include assessment of all major building systems, as outlined in Table 1. The inspections should include all the major equipment outlined in the energy audit methodology of a standard such as ASHRAE Standard 211 or ISO 50002, with a focus on fossil-fuel combustion equipment on site.

Initial Assessment Report (IAR)

Shortly after the on-site inspection, the auditor will provide an initial assessment report (IAR) to the Owner and schedule a meeting to discuss the findings. A recommended outline of the IAR is included in Appendix B. The IAR provides the following guidance:

- Initial summary of inspection conditions (prior to detailed analysis)
- ▶ Inventory of on-site emissions sources
- ▶ Emissions reduction considerations
- Operations and maintenance (O&M) improvements that should be addressed in the short term
- A list of potential emissions reduction measures (ERMs)

O&M improvements identified by the auditor in the IAR should be implemented by the owner and building operator in the short term. Examples of O&M improvements include:

- ► Reprogramming of thermostats and lighting controls to setback during unoccupied hours
- Coordination of setpoints to avoid simultaneous heating and cooling
- ► Replacement/calibration of sensors, replacing clogged filters, and other maintenance issues
- Adjustment of economizer operation

The owner should review the IAR and provide feedback to the auditor to confirm that the potential ERMs that will be investigated during the Analysis and Reporting task align with the owner's targets and capital plans. In discussing the IAR findings, the owner and auditor may consider revising emissions reduction targets higher or lower based on this initial assessment.

Table 1. On-site Inspection Scope

Typical Energy Audit Scope

Building Envelope:

- Evaluate glazing condition and quality of seals.
- Visually assess the condition of the existing building envelope.

HVAC and Domestic Hot Water Systems:

- Inventory the HVAC system's condition.
- Assess controls, including sequences and setpoints.
- ► Evaluate ventilation flows, economizer operation, and heat recovery systems.
- Identify equipment in need of repair or near end of life.

Lighting/Plug Loads:

- Assess current lamp technology and candidates for retrofits or replacements (interior and exterior).
- Inspect lighting controls and operation (occupancy sensors, daylight sensors, time clocks).
- Assess IT and equipment plug loads in typical spaces.

HVAC and Domestic Hot Water Electrification:

- Assess feasibility for changes in HVAC system type for electrification or major efficiency improvement.
- Analyze an inventory of all refrigerant volumes and refrigerant types.
- ▶ Document any space constraints that would affect future equipment replacements.

Electrical Service:

- Assess existing electrical service capacity by adding nameplate capacity of the connected equipment.
- Identify and document electrical panels situated in locations suitable for future gas equipment replacements or EV charging.
- Make note of available breakers for future electrification loads.

Combustion Appliances:

Assess gas-fired equipment such as cooking equipment, clothes dryers, and fireplaces.

On-site Renewable Energy:

- Assess the roof condition and availability of space on the roof or elsewhere on site for solar photovoltaic (PV) panels.
- Consider other renewable energy sources, as appropriate.

ADDITIONAL GHG EMISSIONS REDUCTION AUDIT SCOPE

Analysis and Reporting

Task 3 includes a detailed analysis of emissions reduction measures and then combines measures into low-emissions measure packages that achieve intended reduction targets. In addition to cost and savings analysis, this task includes an assessment of implementation phasing. The task culminates in an emissions reduction audit report for the building.

Emissions Reduction Measures

The ERMs that should be assessed in the Emission Reduction Audit are shown in Table 2 below, organized by measures typically included in an energy audit and additional GHG emissions-reduction measures.

The auditor should provide a summary of all ERMs identified for the building. The summary should include the impacts on operational costs, energy use, and emissions, as outlined in Table 3. The emissions reductions should be calculated using emissions factors coordinated between the owner and auditor in Task 1. At a minimum, the measure should include an estimate of first costs and a simple payback calculation; however, the owner may elect to have the auditor conduct a more comprehensive lifecycle cost analysis to understand the long term financial effects. The summary table also should include a recommended prioritization or implementation schedule, estimated first cost, and simple payback period. Depending on the local electric grid emissions, electrification of systems may increase GHG emissions in the near term prior to the decarbonization of the electric grid, however on-site renewables and green power procurement can reduce this impact.

Typical Energy Audit Scope

Energy Efficiency ERMs

- Energy efficiency measures should include all major building systems (building envelope, HVAC, domestic hot water, electrical, lighting, receptacle loads, etc.).
- ▶ As applicable, measures should include evaluation of building controls and additional sensor-based capabilities, such as daylight dimming, demand control ventilation and occupancy-based lighting, and thermostat controls.
- ▶ Measures should include an assessment of energy management and information system (EMIS) opportunities to enable tracking energy and emissions performance over time.

Electrification ERMs (includes partial electrification solutions)

- Provide at least one all-electric replacement option for all fossil-fuel combustion equipment on site (boilers, furnaces, cooking, fireplaces, and other devices). Replacement of heating equipment should utilize heat pumps and limit electric resistance heating. The analysis of this option should include needs for upgrading building electrical service.
- ▶ Partial electrification of fossil-fuel combustion equipment is a viable solution that can provide significant emissions reductions. An example of a partial electrification solution is the use of heat pumps to serve most loads, supplementing with gas equipment for peak loads or back-up heating.
- ▶ Electrification may require reduction in peak heating load through a combination of energy efficiency and thermal energy storage.

Fugitive Emission Reduction ERMs

- Include measures to mitigate leaks from equipment containing refrigerants.
- ▶ Investigate the use of low-global warming potential (GWP) refrigerants as part of any ERMs with new heat pump or refrigeration equipment.

Renewable Energy ERMs

- ▶ Include a feasibility study of on-site renewable energy production based on the available space noted during the onsite inspection.
- ▶ Renewables can include solar PV, solar thermal, and wind turbines, depending on the climate and solar/wind resources.
- ▶ The assessment should include viability of installation on the building roof or surrounding property, such as PV parking canopies or on-grade installations. The assessment should include analysis of local shading conditions and code constraints that may limit the availability of space for potential solar capacity.
- The owner may elect to use a separate consultant to provide the renewable energy assessment. In such an instance, the renewable energy assessment should be provided to the auditor for inclusion in the ERM analysis and measure packages.

ADDITIONAL GHG EMISSIONS REDUCTION AUDIT SCOPE

Table 3. Typical ERM Summary Example

EMISSIONS REDUCTION MEASURE	ERM DESCRIPTION
ELECTRICITY SAVINGS	Annual kWh saved
NATURAL GAS SAVINGS	Annual therms saved
ENERGY COST SAVINGS	Annual cost saved
ANNUAL GHG EMISSIONS REDUCTION	Annual lbs CO ₂ -equivalent saved
FIRST COST	Estimated implementation on costs
SIMPLE PAYBACK	First cost/annual energy savings
IMPLEMENTATION TIME FRAME	Low, medium or long term

Low-Emissions Measure Packages

Based on the GHG emissions reduction targets established at the outset of the audit, the auditor will combine identified ERMs from the summary table into packages of measures that meet the building's emissions reduction targets. The Auditor's recommendations should emphasize operational improvements and load reduction first, which can reduce the size of future equipment replacements and increase the impact of any on-site renewable energy systems.

Each low-emissions measure package should include the same information as noted for each individual measure in the ERM summary table but incorporate the interactive impact of multiple measures. For example, lighting upgrades reduce cooling loads, which reduce the required size of HVAC equipment.


The auditor should recommend an order in which each package's measures should be implemented to maximize the emissions benefit and align with the owner's future capital improvement plans. For example, a heat recovery device installed as part of a ventilation system upgrade can reduce peak heating loads, which in turn reduces the capacity requirement for a future heat pump replacement of an existing gas furnace. The proposed packages may include replacements of fossil fuel combustion equipment, but there may also be alternative packages that can achieve the intended emissions targets without full electrification.

Figure 2 provides an example of how the auditor can bundle ERMs in different combinations to provide pathways to the emissions reduction target.

Emissions Reduction Audit Report

The auditor will provide all the inspection and analysis information, including the ERMs and low-emissions measure packages, in a summary report for the owner. An example audit report outline is provided in Appendix B.

Figure 2. Low Emissions Measure Packages to Achieve 50% Emissions Reduction

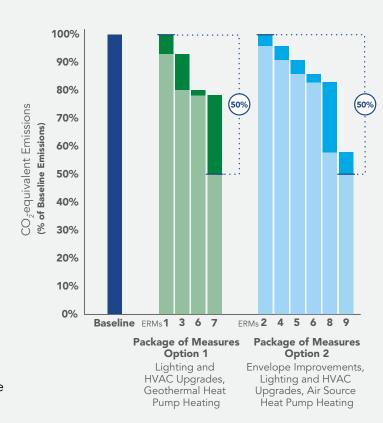



Selection and Implementation by Owner

Once a pathway has been selected, the owner can develop the scope of work for ERMs that may require a request for proposals (RFPs) to solicit bids. Some ERMs may be installed readily, while others may require design engineering and building permits to implement properly. After ERMs have been implemented, all equipment should be commissioned to verify that the modified systems will perform as intended.

The ERMs identified in the building-level emission reduction audit also can be used to inform an owner's portfolio-level plans. The owner can extrapolate results from the audit across similar buildings to estimate emission reduction impacts across their portfolio. This can help the owner understand additional efforts needed to reduce meet portfolio-level emissions reduction targets, such as investment in off-site renewable energy capacity.

Optional Audit Scope

If possible, the following activities should be included in the Emissions Reduction Audit scope. Some of these tasks may not be applicable to the building (e.g., electrical panel load study) or may be planned for the future (e.g., monitoring-based commissioning).

Electrical Panel Load Study

Electrical capacity constraints can be a barrier to replacing fossil-fuel combustion equipment with electrically powered alternatives. New equipment, such as heat pumps or induction cooktops, may require electrical service that exceeds the "nameplate" rating of available electrical panel capacity. However, it is possible that previously connected equipment does not utilize all the allocated capacity.

The owner may consider implementing a detailed study of historical electrical loads to understand how much of the building's rated electrical supply is used during operation and develop a more detailed assessment of availability of capacity to support heat pumps, EV chargers, and other electrified equipment included in decarbonization measures. This analysis can help to reduce or avoid the cost of installing additional electrical infrastructure.

A load study requires an electrical engineer to review historical meter data, measure building loads, and assess existing infrastructure and capacity at existing panels, which is beyond the basic scope of an audit. This study should be done prior to the audit analysis (Task 3) so an understanding of available capacity can be included in the development of ERMs and cost analysis.

Figure 3. Owner Considerations



Existing Building Commissioning or Monitoring-based Commissioning

The owner may request that the auditor provide an indepth commissioning process to address operational improvements of existing systems, especially when the HVAC systems are complex. Existing building commissioning generally includes a deeper level of control system trend data analysis than an energy audit. Further, the commissioning provider can support the owner in implementing an energy management and information system (EMIS) to continuously track building performance and identify areas of degradation and additional savings opportunities. For information on monitoring-based commissioning using an EMIS, see the DOE's Smart Energy Analytics Campaign Toolkit.

Energy Storage Assessment

The owner may request that the auditor evaluate the potential for on-site battery storage and/or thermal energy storage. While storage does not directly reduce energy consumption, it can supplement heat pumps in an all-electric heating scenario and reduce the need for additional costly infrastructure when transitioning away from on-site fossil-fuel usage. Energy storage also can reduce peak demand charges or reduce dependency on fossil fuel-based emergency backup generators.

Demand Management and Load Flexibility Assessment

The auditor may evaluate the current controls infrastructure for the feasibility of participating with local demand management programs. Load flexibility can help alleviate peak loading on power grids and potentially allow the building to respond to time-based carbon emissions factors. Examples of methods to reduce peak demand include:

- Adjustment of thermostat setpoints
- Shutoff of non-essential lighting
- Operation of energy storage equipment

The auditor may present options to the owner to implement demand management and evaluate the financial benefits of participating in a demand management program.

EV Charging Assessment

The auditor may evaluate the feasibility of adding EV charging stations to the building and consider smart charging strategies to manage peak demand. This assessment would require evaluation of electrical capacity, ability to submeter the chargers for energy monitoring, and whether additional electrical infrastructure would be needed to handle the loads in parking areas.



GHG Emissions Reduction Audit Checklist

This checklist is a summary of the steps necessary for a successful greenhouse gas (GHG) emissions reduction audit. The building owner can use this checklist to validate the scope of the audit. Please refer to the Emissions Reduction Audit Guidance narrative for more description of audit tasks and additional services that could be included.

Data Collection and Goal Setting The owner compiles records of all metered energy data, as-built drawings, and equipment submittals for the auditor, as well as results from any previous energy audits. At a minimum, monthly energy use data over a multiple year span, including at least one year prior to 2020, should be provided. The owner or auditor calculates current Scope 1 and 2 emissions for the total building based on metered data and applicable GHG emissions factors (using GHG Inventory data if available). The owner and auditor work together to develop goals for the Scope 1 and 2 operational emissions reductions for the audited building. This audit is intended to confirm this building's potential contribution to the portfolio-level target through improvements to the site. Targets should not include the use of RECs or green power purchases. TASK 2 **On-site Inspections** Assess the building systems for potential operational deficiencies and opportunities for emission reductions: Building envelope HVAC equipment and controls Domestic hot water heating Lighting and controls Receptacle loads Refrigeration systems Fossil-fuel combustion appliances and equipment Building-level and end-use metering Evaluate electrical service capacity to the building and panel locations where future equipment could

Owner Considerations:

- ▶ The building's emissions may already have been calculated as part of a portfolio-level analysis. In this case, the owner can share monthly energy and emissions data directly with the auditor.
- ▶ Consider how the emissions reductions targets for this building relate to your organization's portfoliolevel emissions goals. These may be driven by internal mandates, local building performance standards, or upcoming GHG emission legislation.
- ▶ The GHG emissions factors used in the analysis should be agreed upon prior to the audit and should follow industry standard emission factors as published by the EPA or IPCC. The owner may elect to also evaluate projections of future emissions factors to reflect changes on grid emissions.
- Communicate to the auditor any significant capital plans for the building in the next five years, known end-oflife equipment replacement, or anticipated changes in occupancy or operations.

PV or solar thermal.
Identify O&M improvements for immediate rectification.
Provide an Initial Assessment Report (IAR) after the inspections but prior to the detailed analysis. The auditor, owner, and Building operator should coordinate on measures to include in the Analysis portion of the audit.

Investigate solar readiness and availability of space for

Owner Considerations:

Meet with the auditor to discuss the Initial Assessment Report and review the findings together. Confirm that the auditor inspected all major building systems and agree on a selection of potential options to analyze as part of the Task 3 analysis.

breakers for future loads.

refrigerants.

be added. Identify and document electrical panels in locations where future gas equipment replacements

or EV chargers may be located. Make note of available

Analyze an inventory of all equipment containing

TASK 3 Analysis and Reporting

	, , ,	
	Identify Emissions Reduction Measures (ERMs) to lower GHG emissions:	 Fugitive Emissions ERMs Include measures to mitigate leaks from equipment containing refrigerants.
	Energy Efficiency ERMs	 Consider low-GWP refrigerants during equipment
	Provide measures that reduce primary energy consumption within the building.	replacements.
	Include options for all major building systems (building	Renewable Energy ERMs
	envelope, HVAC, domestic hot water, electrical, lighting, receptacle loads, etc.).	Include a feasibility study of on-site renewable energy on the rooftop or the surrounding property.
	 Evaluate upgrades to building controls and additional controls for lighting and HVAC systems. 	Provide estimates for each ERM in terms of energy
	► Energy efficiency ERM scope should be aligned with an energy audit scope of work (such as ASHRAE Standard 211 Level 2 or ISO 50002 Type 2).	savings, cost savings, and carbon emissions reductions using grid emissions factors determined in Task 1.
	Electrification ERMs	Develop Low-Emission Measure Packages that represent achievable levels of emissions reductions at
	Provide at least one all-electric ERM option to replace all the fossil-fuel combustion equipment on site.	the building level (without the use of RECs or green power purchases).
	 Consider partial electric or hybrid solutions to supplement existing fossil-fuel combustion equipment or provide backup to a heat pump during cold temperatures. 	 Outline potential implementation phasing and scheduling of retrofits.
		 Assess whether Low-Emission Measure Packages meet the owner's emissions reduction targets.
	 Consider thermal energy storage to reduce peak heating loads in support of heat pump retrofits. 	 Address compliance with any current or upcoming local jurisdiction emissions mandates.
	 Evaluate opportunities to electrify process loads, such as cooking, clothes drying, and fireplaces. 	 Provide a preliminary assessment of capital costs, including costs required to upgrade building infrastructure.
		The auditor provides an Emissions Reduction Audit Report to the owner and meets to review the results.

Owner Considerations:

- ▶ The auditor should include savings in terms of percent reduction of each fuel type for the measure packages for use in portfolio-level planning estimates.
- ▶ The renewable energy assessment could be provided by a separate consultant. The results of this assessment should be provided to the auditor for inclusion in the Low-Emission Measure Packages.
- ▶ The auditor should recommend an order in which the ERMs should be implemented to maximize the emissions benefits and align them with the owner's future capital improvement plans.
- ▶ The use of RECs, off-site renewable energy capacity, or green power purchases (which are generally purchased at a portfolio level) are outside the scope of this building-level audit. These procurements could be considered by the owner to bridge the difference between practical levels of emissions reductions at a building site level and overall portfolio emissions reduction targets.

TASK 4 Selection and Implementation (Owner tasks)
Evaluate options and work with the auditor to select a preferred strategy to achieve the emissions reduction targets.
Evaluate how proposed building improvements can be integrated into long-term capital plans.
Develop a scope and solicit bids for emissions reduction projects.
With the auditor, develop commissioning plans to verify that new or modified equipment is performing as intended.
Carry out the emissions reduction projects.

Owner Considerations:

- ▶ Evaluate emissions reduction options based on the energy and emissions savings, first cost, lifecycle cost, and payback period. The options should align with capital planning cycles and could be implemented as a single retrofit or phased over time.
- ► The owner can use building audit results to help inform progress towards portfolio-level emissions reductions targets.



Resources

ASHRAE. (2018). **Standard 211-2018: Standard for Commercial Building Energy Audits.**ASHRAE and ACCA. https://ashrae.iwrapper.com/ASHRAE_PREVIEW_ONLY_STANDARDS/STD_211_2018

International Organization for Standardization (2014). **ISO 50002:2014: Energy audits — Requirements with guidance for use.** https://www.iso.org/standard/60088.html

Kramer, H., T. Abram, N. Hart, J. Granderson (2023). **Framework for Greenhouse Gas Emissions Reduction Planning: Building Portfolios** U.S. Department of Energy. https://betterbuildingssolutioncenter.energy.gov/sites/default/files/attachments/_ERP_Framework_Building_Portfolios.pdf

National Renewable Energy Laboratory. (2022). **Greenhouse Gas Emissions Accounting in Buildings.** Fact Sheet. https://www.nrel.gov/docs/fy22osti/81671.pdf

U.S. Department of Energy. (2022). **Low Carbon Strategies Toolkit.** https://betterbuildingssolutioncenter.energy.gov/toolkits/low-carbon-technology-strategies-toolkit

U.S. Department of Energy. (2021). **Decarbonizing HVAC and Water Heating in Commercial Buildings.** https://betterbuildingssolutioncenter.energy.gov/sites/default/files/attachments/Decarbonizing%20HVAC%20and%20Water%20Heating%20in%20Commercial%20Buildings%2011.21.pdf

Audit Deliverables

This appendix includes suggested outlines for the reports to be provided by the auditor to the owner. It outlines the information and level of detail that should be expected of the auditor's deliverable.

Initial Assessment Report (IAR) Outline

This report is delivered to the owner after the on-site inspection and prior to detailed analysis.

ON-SITE INSPECTIONS SUMMARY		
SUMMARY OF INSPECTED CONDITIONS	 Building envelope HVAC Domestic hot water systems Lighting/electrical Plug loads 	
INVENTORY OF ON-SITE EMISSIONS SOURCES	 Space heating equipment Hot water heaters Combustion appliances (cooking equipment, clothes dryers, fireplaces) Miscellaneous combustion equipment Assessment of refrigerant volumes and types 	
EMISSIONS REDUCTION CONSIDERATIONS	 Assessment of existing electrical service Evaluation of space constraints for future equipment replacements Assessment of roof condition and availability of space for renewable energy 	
	PROPOSED ANALYSIS AND IMPLEMENTATION	
LOW COST FIXES	► Energy performance deficiencies that require little cost or time to implement	
POTENTIAL EMISSIONS REDUCTION MEASURES FOR FURTHER STUDY (ERMS)	 Auditor recommendations for further study during the Analysis and Reporting task Description of ERMs provided for owner feedback 	

Emission Reduction Audit Report Outline

This report is delivered to the owner as the final audit deliverable.

	EXISTING BUILDING EMISSIONS ASSESSMENT
BUILDING DESCRIPTION	 Facility Description Summary of Existing Conditions Building envelope HVAC systems Service hot water systems Lighting Process and plug loads Fossil-fuel combustion equipment Electrical service description
HISTORICAL EMISSIONS ANALYSIS	 Historical Energy Use Analysis Historical Emissions Analysis Benchmarking (ENERGY STAR Portfolio Manager or other suitable comparison) Definition of emissions factor for each energy source
EMISSIONS REDUCTION TARGETS	 Discussion of target for GHG emissions reduction Analysis of mandated emissions requirements
	BUILDING IMPROVEMENTS
LOW COST FIXES	► Energy performance deficiencies that require little cost to implement
PROPOSED EMISSIONS REDUCTION MEASURES (ERMS)	 Energy and GHG emissions savings for each ERM Energy efficiency ERMs Electrification ERMs Fugitive emissions ERMs Renewable energy ERMs Cost estimates and payback analysis Capital planning on measure implementation
LOW-EMISSIONS MEASURE PACKAGES	 Recommended measure packages proposed by the Auditor to achieve emissions reduction targets Estimate of phased implementation Measure package cost assessment
	ADDITIONAL AUDIT SERVICES (OPTIONAL)
ADDITIONAL AUDIT SERVICES	 Electrical panel load study Existing building commissioning or monitoring-based commissioning Energy storage assessment Demand management and flexibility assessment EV charging assessment
SUPPORTING DOCUMENTATION	 Data collected from on-site inspections Calculations supporting analysis results Tabulated utility data and rates

Copyright

This manuscript has been authored by Lawrence Berkeley National Laboratory under Contract No. DE-AC02-05CH11231 with the U.S. Department of Energy. The U.S. Government retains, and the publisher, by accepting the article for publication, acknowledges, that the U.S. Government retains a non-exclusive, paid-up, irrevocable, world-wide license to publish or reproduce the published form of this manuscript, or allow others to do so, for U.S. Government purposes.

Disclaimer

This document was prepared as an account of work sponsored by the United States Government. While this document is believed to contain correct information, neither the United States Government nor any agency thereof, nor The Regents of the University of California, nor any of their employees, makes any warranty, express or implied, or assumes any legal responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by its trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof, or The Regents of the University of California. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof, or The Regents of the University of California.

Ernest Orlando Lawrence Berkeley National Laboratory is an equal opportunity employer.

Citation

Kramer, H., J. Granderson, N. Hart, and D. Luddy. (2023). *Greenhouse Gas Emissions Reduction Audit: A Checklist for Owners*. U.S. Department of Energy.